



HRFW EC ...

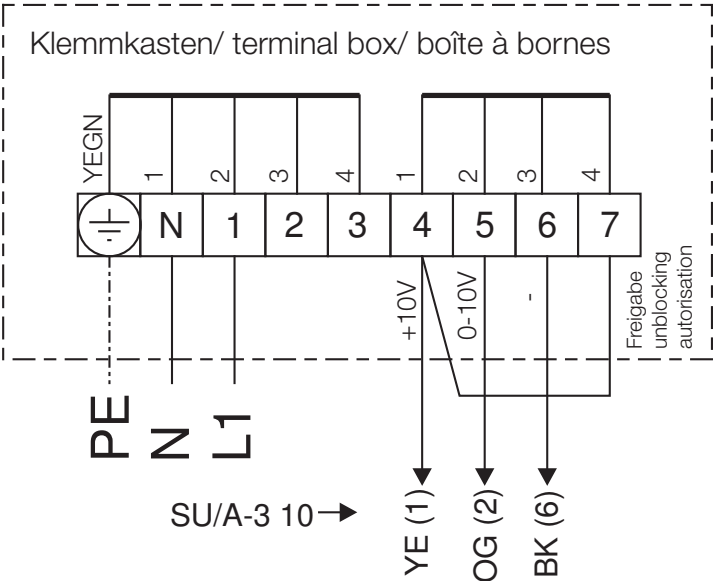

HQW EC ..., HWW EC ...


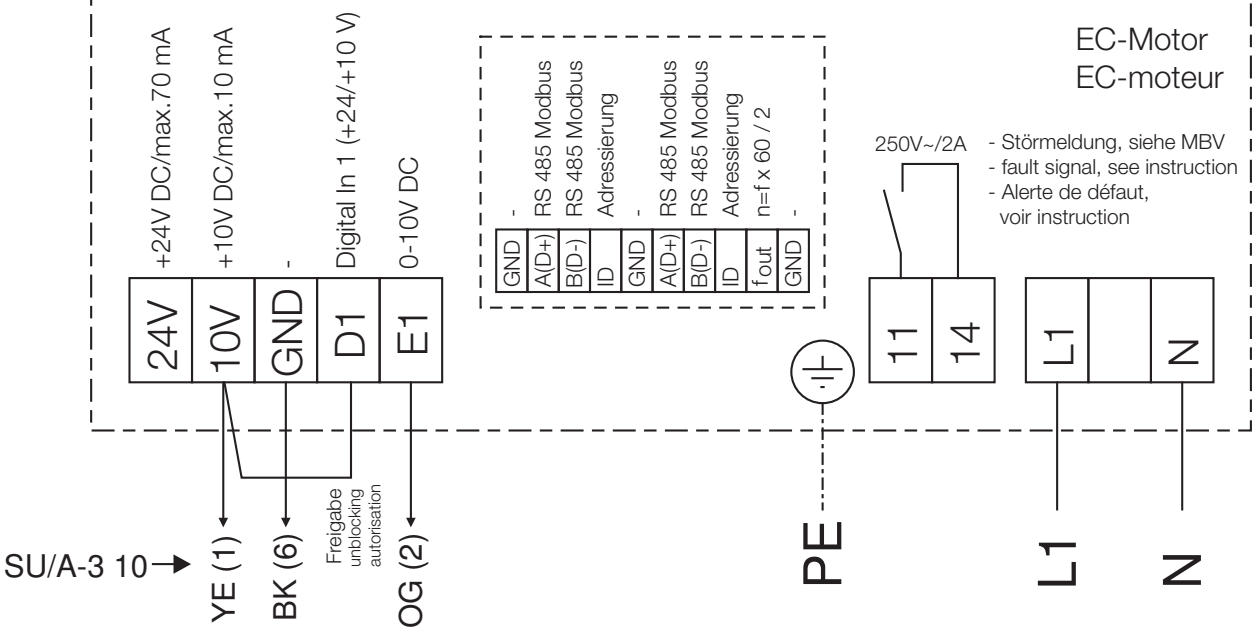


YE: +10V
OG: 0-10V
BK: GND

Farbcode/color code/code couleur (IEC 757)
BK-sw-schwarz-black-noir
OG-or-orange-orange-orange
YE-ge-gelb-yellow-jaune



Ventilator
fan / ventilateur

SU/A-3 10
Art.Nr. 4266/7

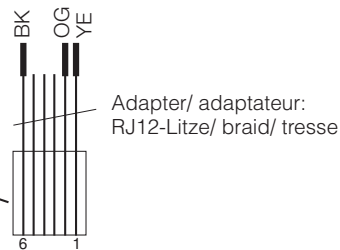


Anschluss der
Klemmen 1/2/3
siehe auch SS-1022
terminal connection
1/2/3 see also
SS-1022

raccordement des
bornes 1/2/3
voir aussi SS-1022



Potentiometer
setpoint setting:
S1 = 0,0-10 V
S2 = 1,7-10 V
S3 = 1,7-10 V
A1 = 1,7-10 V

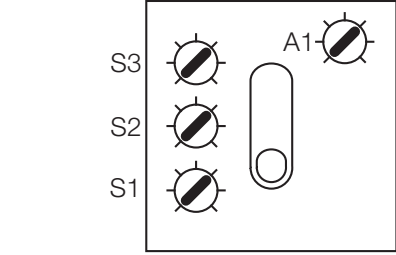

setpoint	link on terminal	
constant Poti A1	1/2	2/3
switch operation, Poti S1 - S3	1/2	2/3

Potentiometer
Sollwertvorgabe:
S1 = 0,0-10 V
S2 = 1,7-10 V
S3 = 1,7-10 V
A1 = 1,7-10 V

point de consigne
du potentiomètre:
S1 = 0,0-10 V
S2 = 1,7-10 V
S3 = 1,7-10 V
A1 = 1,7-10 V

Brücke auf Klemme	
Sollwert	1/2 2/3
Festwert Poti A1	✓ -
Schalterbetrieb, Poti S1 - S3	- ✓

Pont entre bornes	
Point de consigne	1/2 2/3
Poti A1 constant	✓ -
fonctionnement du com- mutateur, Poti S1-S3	- ✓