
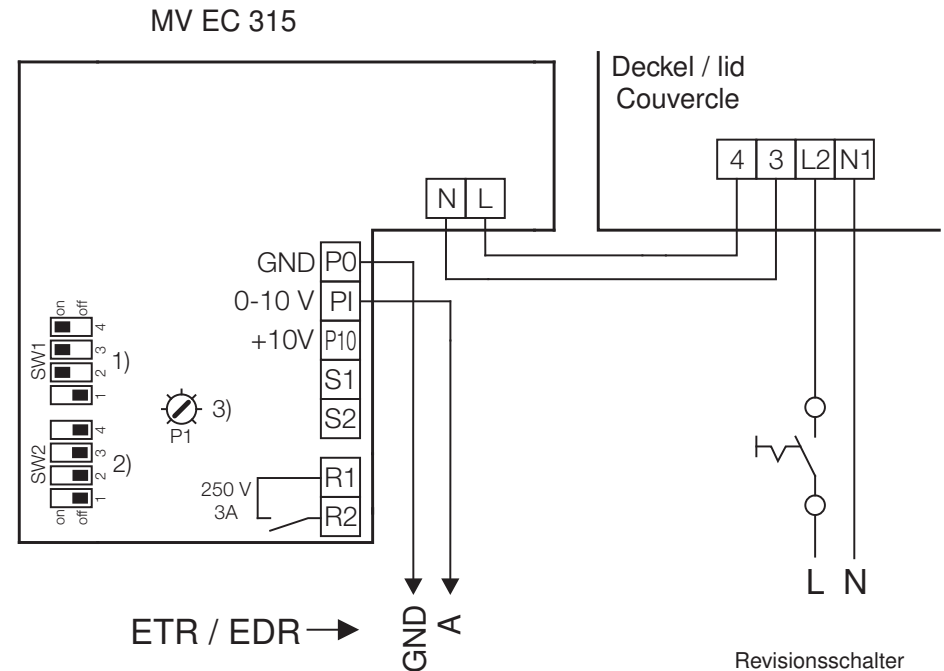


! Steuerleitungen max. 30m, ab 20m abgeschirmt, siehe Montage- und Betriebsvorschrift !
control cables max. 30m, shielded from 20m, see Installation and Operating Instruction !
Cables de commande max. 30m, blindés à partir de 20m, voir Notice d'installation et de montage !

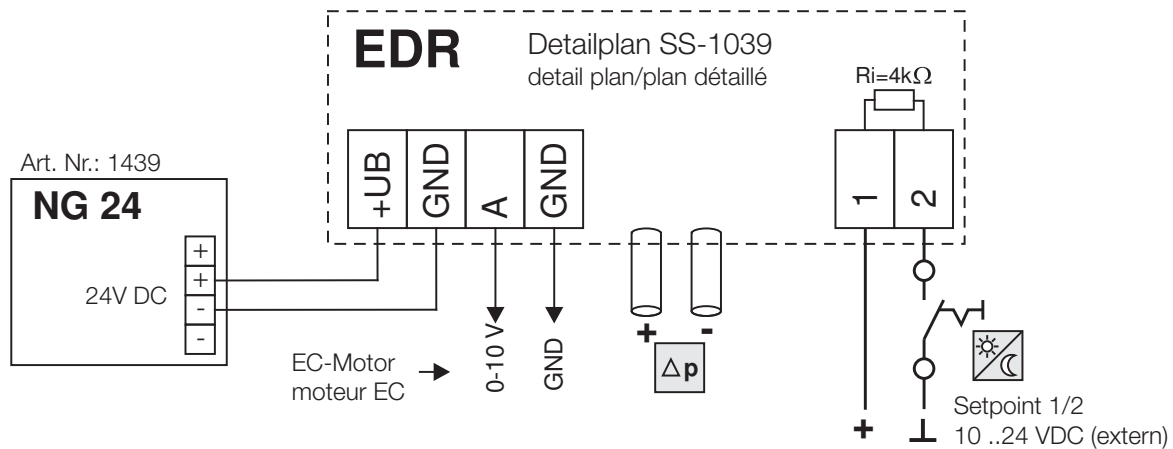

Revisionsschalter
bauseits zu stellen

Isolation switch
to be provided by
customer

interrupteur de
(fourniture client)
resp.