




AIR1 XH 7000

Separable casing design

Fig. shows accessories

EUROVENT CERTIFIED PERFORMANCE

TCM 300

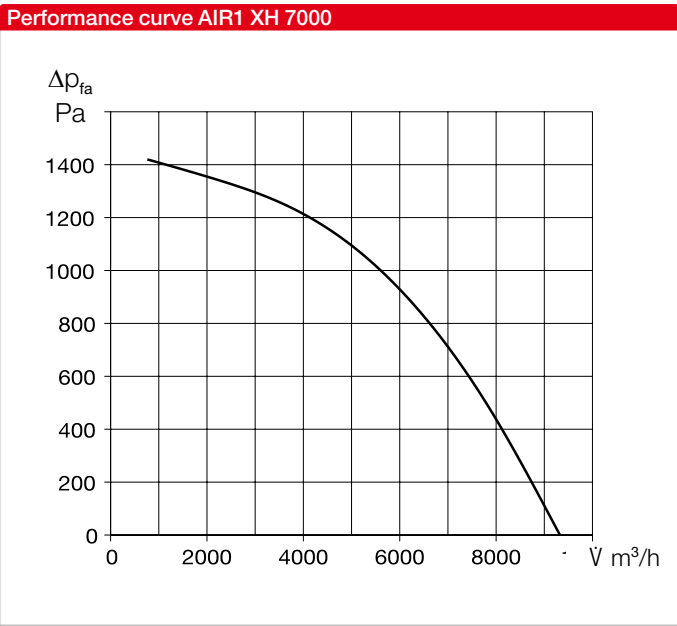

Unit type

Ref. no.	AIR1 XH 7000
Heat exchanger	04341
	Cross-counterflow

Technical data

Mechanical data	
Area of application	Inside/outside
Installation position	standing
Maintenance access	Side, both sides
Min. air volume	1,080 m³/h
Max. air volume ERP	6,310 m³/h (1)
Max. air volume (free blowing)	9,300 m³/h
Weight, unit operational	1,080 kg
Delivery unit	3-part
Unit segments	3
Housing class (DIN 1886)	T2 / TB2 / D2
Filter Outside air	ISO ePM ₁ 55% (F7) (2)
Filter Extract air	ISO ePM ₁₀ 50% (M5) (2)
Media temperature (air)	-20 to +50 °C
Ambient temperature (place of installation)	-20 to +50 °C
Protection class	IP31
Electrical data	
Central building control system	BACnet, Modbus TCP/IP
Voltage / Frequency	400 V 3N ~, 50 Hz
Max. output Fans	2 x 3,600 W
Max. output elec. pre-heater	21,000 W
Nominal current	
– Ventilation unit	41.3 / 41.3 / 42.3 A (3)
– Electrical auxiliary heater	30.3 / 30.3 / 30.3 A (4)
– max. total	71.6 / 71.6 / 72.6 A
Connection (wiring diagram no.)	1332


(1) = at 400 Pa external pressure loss ERP-compliant
(2) = other filter classes see optional accessories
(3) = includes electrical pre-heater
(4) = Optional accessories

Sound data

Sound power level L _{WA} dB(A) at 400 Pa external pressure			
	2,200 m³/h	4,400 m³/h	6,310 m³/h
Supply air (L _{WA})	78	81	85
Extract air (L _{WA})	64	63	68
Outside air (L _{WA})	67	62	66
Exhaust air (L _{WA})	77	80	86
Sound pressure level L _{pA} dB(A) of sound radiated from housing			
	2,200 m³/h	4,400 m³/h	6,310 m³/h
Housing rad. 1 m	47	48	49
Housing rad. 3 m	37	39	40
Housing rad. 5 m	33	34	35

The sound power at the connectors is calculated for the simultaneous operation of both fans. The sound pressure level is determined for the simultaneous operation of both fans at distances of 1, 3 and 5 m.

Dimensions AIR1 XH 7000

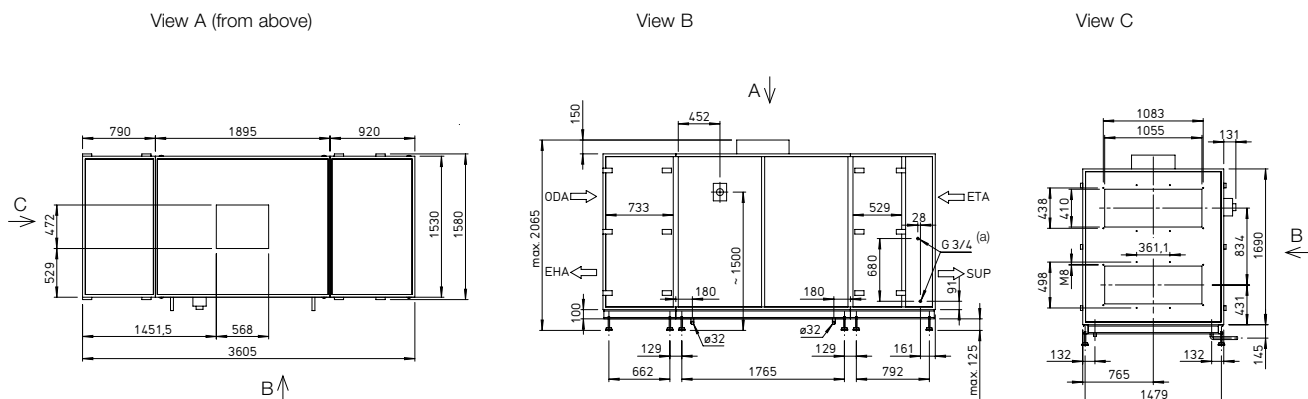

Dimensions in mm

(a) External thread

ODA: Outside air

EHA: Exhaust air

ETA: Extract air

SUP: Supply air

Accessories

Heating and cooling registers

Auxiliary heater

AIR1-ENH XH 7000 Electrical, internal	Ref. no. 03603	Page 94
AIR1-NH WW XH 7000 Hot water, internal	Ref. no. 03689	Page 96

Hydraulic unit for hot water heater register

WHS HE 24 V (0 – 10 V) M	Ref. no. 06310	Page 96
---------------------------------	----------------	---------

Cooling register

AIR1-KR KW XH 7000 L ⁽¹⁾ Cold water, external	Ref. no. 03945	Page 100
AIR1-KR KW XH 7000 R ⁽¹⁾ Cold water, external	Ref. no. 04281	Page 100
AIR1-CO DX XH 7000 L ⁽¹⁾ Change-over, external	Ref. no. 04414	Page 106
AIR1-CO DX XH 7000 R ⁽¹⁾ Change-over, external	Ref. no. 03123	Page 106
AIR1-SM DX ⁽²⁾ Control module	Ref. no. 40408	Page 110

Air routing

Multi-leaf damper

AIR1-JVK XH 7000/RH 8000	Ref. no. 06012	Page 111
---------------------------------	----------------	----------

Recirculation kit

AIR1-ULK XH 7000	Ref. no. 06028	Page 110
-------------------------	----------------	----------

Flexible connector

AIR1-VS 105/41	Ref. no. 04376	Page 113
-----------------------	----------------	----------

Potential equalisation cable

PAK M8	Ref. no. 40812	Page 113
---------------	----------------	----------

Condensate drainage

Ball siphon

AIR1-KS B for use with floor-mounted units and cooling register	Ref. no. 07169	Page 114
---	----------------	----------

External installation

Cover for external installation

AIR1-AAD XH 7000 Weather protection cover for the unit	Ref. no. 06350	Page 116
--	----------------	----------

AIR1-AAD KR KW + DX XH 7000

Weather protection cover for cooling register cold water or direct evaporator	Ref. no. 06465	Page 118
---	----------------	----------

Terminal box heater

AIR1-AAHK	Ref. no. 07064	Page 114
------------------	----------------	----------

Hoods

AIR1-AAHA XH 7000/RH 8000

Intake hood outside air	Ref. no. 06497	Page 115
-------------------------	----------------	----------

AIR1-AAHF XH 7000/RH 8000

Discharge hood exhaust air	Ref. no. 06841	Page 115
----------------------------	----------------	----------

Controls

Controllers

AIR1-BE ECO	Ref. no. 06186	Page 119
AIR1-BE TOUCH	Ref. no. 06187	Page 119

Controller connection cable

AIR1-SL 4/10 10 m	Ref. no. 07073	Page 119
AIR1-SL 4/20 20 m	Ref. no. 07121	Page 119

Sensors

AIR1/KWL-VOC 0-10V Mixed gas sensor	Ref. no. 20250	Page 119
AIR1/KWL-CO2 0-10V Carbon dioxide sensor	Ref. no. 20251	Page 119
AIR1/KWL-FTF 0-10V Humidity-temperature sensor	Ref. no. 20252	Page 119
AIR1-CO2 K Carbon dioxide sensor duct	Ref. no. 07124	Page 119

Signal converter for sensors

AIR1-SK	Ref. no. 06019	Page 120
----------------	----------------	----------

Extension kit for constant pressure control

AIR1-CAP	Ref. no. 06756	Page 120
-----------------	----------------	----------

Duct smoke detector with VdS approval

RMK	Ref. no. 04982	Page 120
------------	----------------	----------

Duct smoke detector with DIBT approval

KRM	Ref. no. 40825	Page 120
KRM-MK Mounting bracket for KRM	Ref. no. 40826	Page 120
KRM-G Protective housing	Ref. no. 40847	Page 120
KRM-MKG Mounting bracket for protective housing	Ref. no. 40848	Page 120

Air filters

Spare air filter and other filter classes

ELF-AIR1 XH 7000/ePM10 50%/48 (M5)	Ref. no. 02187	Page 122
ELF-AIR1 XH 7000/ePM10 50%/96 (M5)	Ref. no. 02209	Page 122
ELF-AIR1 XH 7000/ePM1 55%/96 (F7)	Ref. no. 02234	Page 122
ELF-AIR1 XH 7000/ePM1 80%/96 (F9)	Ref. no. 02435	Page 122

The use of original spare air filters is mandatory to guarantee the specified technical data and air volumes.

(1) = When looking at the cooling register from the air flow direction, the service side is on the right for the R version and on the left for the L version.

(2) = Necessary accessory in connection with an AIR1-CO DX change-over register for connecting an AIR1 ventilation unit of the XC, XH and RH series to the control of an on-site cooling system.