


**KWL EC 1800 S**



KWL EC 1800 S with base cover (accessories)



**Dimensions KWL EC 1800 S**

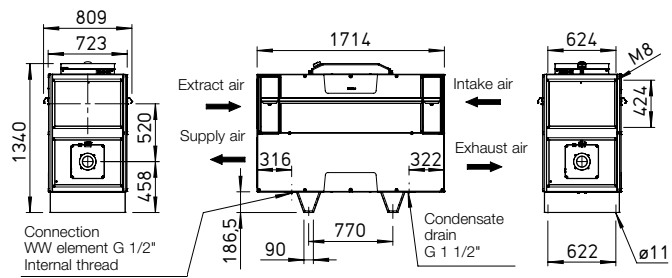

Dimensions in mm



Central units with heat recovery for compact and space-saving floor installation (floor standing).

With a wide range of residential, commercial and industrial applications.

Independently certified hygiene properties and energy efficiency according to VDI 6022 and the passive house standard. Unit construction and unit components fulfil the general hygiene requirements according to VDI 6022. Optionally available with integrated warm water heating element.

**■ Casing**

Double-walled, made of galvanised steel sheet, with 30 mm heat and sound insulation on all sides. Inspection openings for filter replacement fastened to both side panels with screws. Both side walls can be completely dismantled for free access to all components. The unit is suitable for floor installation (standing) indoors. Vibration dampers can be underlaid (on-site) to prevent the direct transmission of vibrations and structure-borne noise to building parts.

**■ Heat exchanger**

Large cross counterflow heat exchanger made of aluminium with heat recovery efficiency of up to 90 %. Dismantling possible in just a few simple steps.

**■ Fans**

Two low-noise high-performance EC fans with backward-curved impellers guarantee maximum energy efficiency. The special control technology enables constant volume control or constant pressure control.

**■ Ducts**

Installation-friendly connection of intake, exhaust, extract and supply air through pipe or duct system NW 400 mm. The floor-standing unit can be rotated 180° for installation so that intake air and exhaust air as well as extract air and supply air connections can be on the left or right sides.

**■ Condensate connection**

The unit contains a stainless steel condensate tray with a condensate drain below. Ball siphon included in delivery. On-site connection to drain pipe.

**■ Air filter**

Standard equipment: Clean intake air supply via ISO ePM<sub>1</sub> 55% filter (F7). The heat exchanger requires a ISO ePM<sub>10</sub> 50% filter (M5) on the extract air side. All filters are pressure-controlled and exchangeable in just a few simple steps.

**■ Summer operation**

Standard equipment with automatic bypass function for maximum comfort.

**■ Heat exchanger anti-icing protection**

An electric preheating element heats the intake air at very low outdoor temperatures. Thus, it prevents the heat exchanger from icing up and guarantees its safe functioning and optimal heat recovery during the entire heating period.

**■ Power control**

- The comfort control element with graphic display and user-friendly menu navigation, which is included in the delivery, enables the following functions:
- Control directly via touchscreen.
  - Freely definable operating points within the entire range of the performance curve.
  - Selection between constant volume control or constant pressure control.
  - Demand-oriented ventilation using CO<sub>2</sub>, VOC (mixed gas) or humidity sensor.
  - Building control system via ModBus (RS 485, TCP/IP).
  - Initial commissioning (automatic determination of the system performance curve).
  - Control of external shutters.
  - Connection of a fire alarm contact.
  - Weekly or daily programme.
  - Pressure monitoring of filter contamination.
  - Indication of necessary filter replacement, operating status, error messages.
  - Different access levels.

**■ Electrical connection**

Easily accessible terminal box on top of the casing. The isolator/main switch can be controlled from below the unit for maintenance work and it can be locked with a padlock to prevent unauthorised access.

**■ Post-heating Type KWL EC Pro WW**

The integrated warm water heating element guarantees the convenient and energy-efficient post-heating of supply air. The setpoint temperature is simply set in the control element. The hydraulic unit (Type WSH HE 24 V (0-10V), accessories) is recommended for controlling the warm water heat exchanger.

**■ Reference**

The ventilation unit design according to VDI 6022 requires the use of VDI 6022-compliant air filters. The use of original replacement air filters is therefore mandatory.

**■ Replacement air filter**

- 1 pc. ISO ePM<sub>10</sub> 50% (M5) ELF-KWL 1800 S/5 VDI No.08258
- 1 pc. ISO ePM<sub>1</sub> 55% (F7) ELF-KWL 1800 S/7 VDI No.08259

**■ Other accessories Page**


KWL peripherals	150 ff.
– Air distribution systems	166 ff.
– Further overview, control lines	170 f.

**Accessory details**

Ventilation grilles, ducts, fittings	
roof outlets	561 ff.
extract air elements	574 ff.

Performance curve KWL EC 1800 S

Frequency		Hz	Tot.	125	250	500	1k	2k	4k	8k
L <sub>WA</sub>	Extract air	dB(A)	61	54	58	51	52	49	38	14
L <sub>WA</sub>	Supply air	dB(A)	72	61	66	63	65	64	56	56
L <sub>PA</sub>	Radiation	dB(A)	52	35	47	43	47	47	37	28

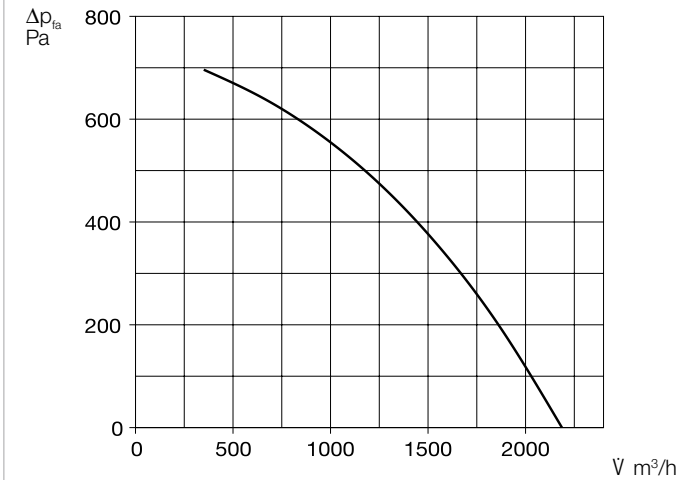

**Included in delivery:**  
**Surface comfort control element**  
User-friendly control via self-explanatory graphic elements with clear text directly on the touchscreen. Control line (10 metres) included in delivery, other lengths available (ALB EC-SK, accessories).  
Dim. mm (WxHxD) 115x80x25



**Accessories for Type Pro WW**  
**Hydraulic unit**  
**WHSH HE 24 V (0-10 V)** No. 08318  
Controls the water temperature of the PWW heating element using a three-way valve actuator 24 V (0-10 V) and thus the heat output transferred to the air. Delivered as a complete unit, incl. VL-/RL temperature display, circulating pump and flexible connection hoses.



Accessories for all types

**Room sensor – Air quality**

**AIR1/KWL-VOC 0-10V** No. 20250  
**AIR1/KWL-CO2 0-10V** No. 20251  
**AIR1/KWL-FTF 0-10V** No. 20252  
For measuring the CO<sub>2</sub>, mixed gas (VOC) concentration or relative room air humidity. A maximum of one sensor can be connected.  
Dim. mm (W x H x D) 85 x 85 x 27



**Room sensor – Temperature**

**TFR-ALB/KWL** No. 07277  
For measuring the room temperature and controlling the ventilation unit according to the set value. Incl. 20 m control line. Maximum total of one sensor can be connected.  
Dim. mm (W x H x D) 80 x 80 x 25



**Transition piece – Symmetrical**


**KWL-ÜS 1800 S** No. 08340  
From unit flange to round duct systems.

**Flexible connecting sleeve**

**FM 400** No. 01676  
For acoustic decoupling, incl. 2 pcs. hose clamps.

**Duct shutter, motorised**

**RVM 400** No. 02580  
Prevents cold draughts when the unit is at a standstill. Automatic function through fan operation, with mounted spring return motor (outside of air flow). Installation in any position.

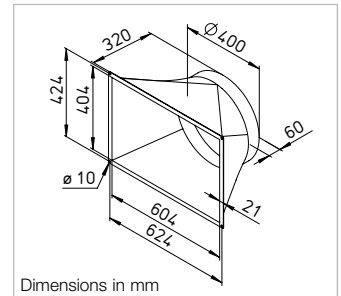

**Angle flange ring**

**FR 400** No. 01206  
Made of galvanised steel sheet, for duct connection.

**Base cover**

**KWL-SB 1800 S** No. 09317  
Made of galvanised steel sheet.



Technical data	KWL EC 1800 S			KWL EC 1800 S, with warm water post-heater		
	Type KWL EC 1800 S Pro	Ref. no. 08329		Type KWL EC 1800 S Pro WW	Ref. no. 08330	
<b>For floor-standing installation</b>						
<b>Flow rate at level<sup>1)</sup></b> Supply air/extract V m <sup>3</sup> /h approx.	1400	1070	810	1400	1070	810
<b>Noise dB(A) at 1400 m<sup>3</sup>/h and 245 Pa</b>						
Supply air L <sub>WA</sub> (sound power)	72	n/a	n/a	72	n/a	n/a
Extract air L <sub>WA</sub> (sound power)	61	n/a	n/a	61	n/a	n/a
Radiation L <sub>PA</sub> at 1 m	52	n/a	n/a	52	n/a	n/a
Power consumption fans 2xW	315	225	165	315	225	165
Standby power consumption	< 1 W			< 1 W		
Voltage/Frequency	3N~, 400 V, 50 Hz			3N~, 400 V, 50 Hz		
Rated current A – Ventilation	3.9 / – / –			3.9 / – / –		
– Preheating	6.6 / 6.6 / 6.6			6.6 / 6.6 / 6.6		
– max. total	10.5 / 6.6 / 6.6			10.5 / 6.6 / 6.6		
Electric preheater kW	4.5			4.5		
Heat output/post-heating element kW	–			5.2 (at 60/40 °C) / 4.9 (at 50/40 °C) / 3.0 (at 40/30 °C)		
Summer bypass	automatic (adjustable), with heat exchanger cover			automatic (adjustable), with heat exchanger cover		
Wiring diagram no.	1370			1370		
Temperature operating range	–20 °C to +40 °C			–20 °C to +40 °C		
Installation temperature	+5 °C to +40 °C			+5 °C to +40 °C		
Connection PWW heating element	–			IG 1/2"		
Weight approx. kg	290			295		

<sup>1)</sup> Values based on operating ranges defined according to PHI (Passive House Institute).