

HINWEISBLATT zur Bedienfeldabdeckung

Zubehör für Typen:

EVS-D.., EVS-DA.., EVS-SD.., EVS-W..

Abb.1



Die Bedienfeldabdeckung, EVS-AD, ist ein Zubehör für die Entrauchungsventilatoren-Steuerungen.

Im Lieferumfang sind enthalten:

- 1 x Bedienfeldabdeckung
- 2 x Schlüssel
- 4 x M3-Schrauben mit Muttern

Maße der Bedienfeldabdeckung:

150 x 150 x 30 mm

⚠ GEFAHR



⚠ Lebensgefahr durch elektrischen Schlag!

Bei der Montage werden spannungsführende Teile freigelegt, die im Fehlerfall bei Berührung zu einem elektrischen Schlag führen. Vor der Montage/Demontage Gerät allpolig vom Netz trennen und gegen Wiedereinschalten sichern (DIN VDE 0105-100; Betrieb von elektrischen Anlagen)!

Personalqualifikation

Installation, Instandhaltungs-, Wartungsarbeiten, Demontage, Montage, Reparatur sowie der Einbau von Ersatzteilen, mit Ausnahme der elektrischen Arbeiten, dürfen nur von eingewiesenen Fachkräften (Bsp.: Industriemechaniker, Mechatroniker, Schlosser oder vergleichbar) ausgeführt werden.


Alle elektrischen Arbeiten dürfen nur von Elektrofachkräften ausgeführt werden.

Bedienungs-, einfache Wartungs- und Reinigungsarbeiten des Gerätes (wie z.B. der Filterwechsel, die Wartung des Kondensatablaufes) dürfen durch den unterwiesenen Nutzer erfolgen.

ACHTUNG

Verbindungskabel zum Bedien- und Anzeigetableau im Gehäusedeckel nicht beschädigen!

Abb.2

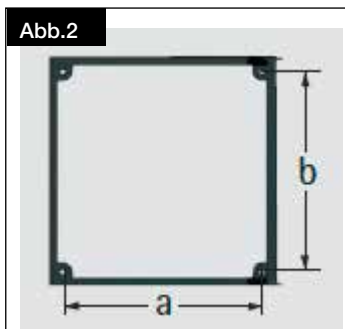

Bohrbild a x b in mm: 125,9 x 125,3

Montage der Bedienfeldabdeckung

1. Bedienfeldabdeckung auf die Entrauchungsventilator-Steuerung legen und die gewünschte Position ggf. markieren.
2. Den Gehäusedeckel von der Entrauchungsventilator-Steuerung lösen.
3. Löcher (Ø 3 mm) für die Befestigung der Bedienfeldabdeckung in den Gehäusedeckel bohren (siehe Bohrbild Abb.2).
4. Die Bedienfeldabdeckung auf der Entrauchungsventilator-Steuerung befestigen.
5. Den Gehäusedeckel an der Entrauchungsventilator-Steuerung befestigen.

HINWEIS

Für mehr Informationen zur EVS, siehe Montage- und Betriebsvorschrift EVS (Art.-Nr. 28 017).

Service und Information

D HELIOS Ventilatoren · Lupfenstraße 8 · 78056 VS-Schwenningen

CH HELIOS Ventilatoren AG · Tannstrasse 4 · 8112 Otelfingen

A HELIOS Ventilatoren · Siemensstraße 15 · 6063 Rum/Innsbruck

F HELIOS Ventilateurs · 9 rue du Gibier · 67120 Molsheim

GB HELIOS Ventilation Systems Ltd. · 5 Crown Gate · Wyncolls Road · Severalls Industrial Park · Colchester · Essex · CO4 9HZ

INFORMATION SHEET for the Control Panel Cover

Accessory for models:

EVS-D.., EVS-DA.., EVS-SD.., EVS-W..



The control panel cover, EVS-AD, is an accessory for the smoke extraction fan control systems.

The delivery includes:

1 x control panel cover

2 x keys

4 x M3 bolts with nuts

Control panel cover dimensions:

150 x 150 x 30 mm

DANGER



 **Danger to life due to electric shock!**

When installing, live parts can be exposed, in the event of a fault, which can result in electric shock if touched. Before dismantling/installation, isolate the unit from the mains power supply and protect against being switching on again (DIN VDE 0105-100; operation of electrical systems)!

Personnel qualification


Installation, servicing, maintenance, removal, assembly, repairs and the installation of spare parts may be carried out by qualified personnel (e.g.: industrial mechanics, mechatronics engineers, metal workers or persons with compatible training) with the exception of electrical work.

All electrical work must only be carried out by qualified electricians.

Operating, simple maintenance and cleaning work on the unit (e.g. filter replacement, maintenance of the condensate drain) must only be carried out by instructed end users.

NOTICE

Do not damage the connection cable to the control and display panel in the housing cover!

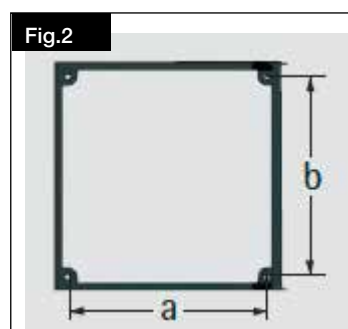

Drilling pattern a x b in mm: 125.9 x 125.3

Control panel cover installation

1. Place the control panel cover on the smoke extraction fan control system and, if necessary, mark the desired position.
2. Remove the housing cover from the smoke extraction fan control system.
3. Drill holes ($\varnothing$ 3 mm) for securing the control panel cover into the housing cover (see drilling pattern Fig.2).
4. Secure the control panel cover onto the smoke extraction fan control system.
5. Secure the housing cover to the smoke extraction fan control system.

NOTE

For more information on the EVS, refer to the EVS installation and operating instructions (Ref. no. 28 017).

Service und Information

D HELIOS Ventilatoren · Lupfenstraße 8 · 78056 VS-Schwenningen

CH HELIOS Ventilatoren AG · Tannstrasse 4 · 8112 Otelfingen

A HELIOS Ventilatoren · Siemensstraße 15 · 6063 Rum/Innsbruck

F HELIOS Ventilateurs · 9 rue du Gibier · 67120 Molsheim

GB HELIOS Ventilation Systems Ltd. · 5 Crown Gate · Wyncolls Road · Severalls Industrial Park · Colchester · Essex · CO4 9HZ